


DIN 72585-A1-3.1-Sn/K1

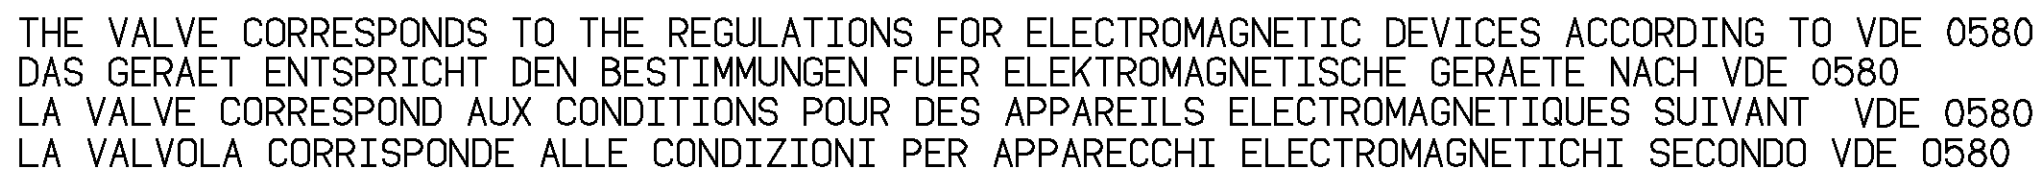

AIR
LUFT
AIR
ARIA

$$U_N = 12 \text{ V DC}^{+20\%}_{-10\%}$$

DISCONTINUOUS SERVICE
AUSSETZBETRIEB ED 5% / 5mtn
SERVICE DISCONTINUE
ESERCIZIO DISCONTINUO


$$I_N \leq 2.22 \text{ A}$$

IP 66, IP 69K
EN 60529/IEC 529

III VDE 0580

$$p_e = \text{MAX}.11 \text{ bar}$$

-40° C +80° C

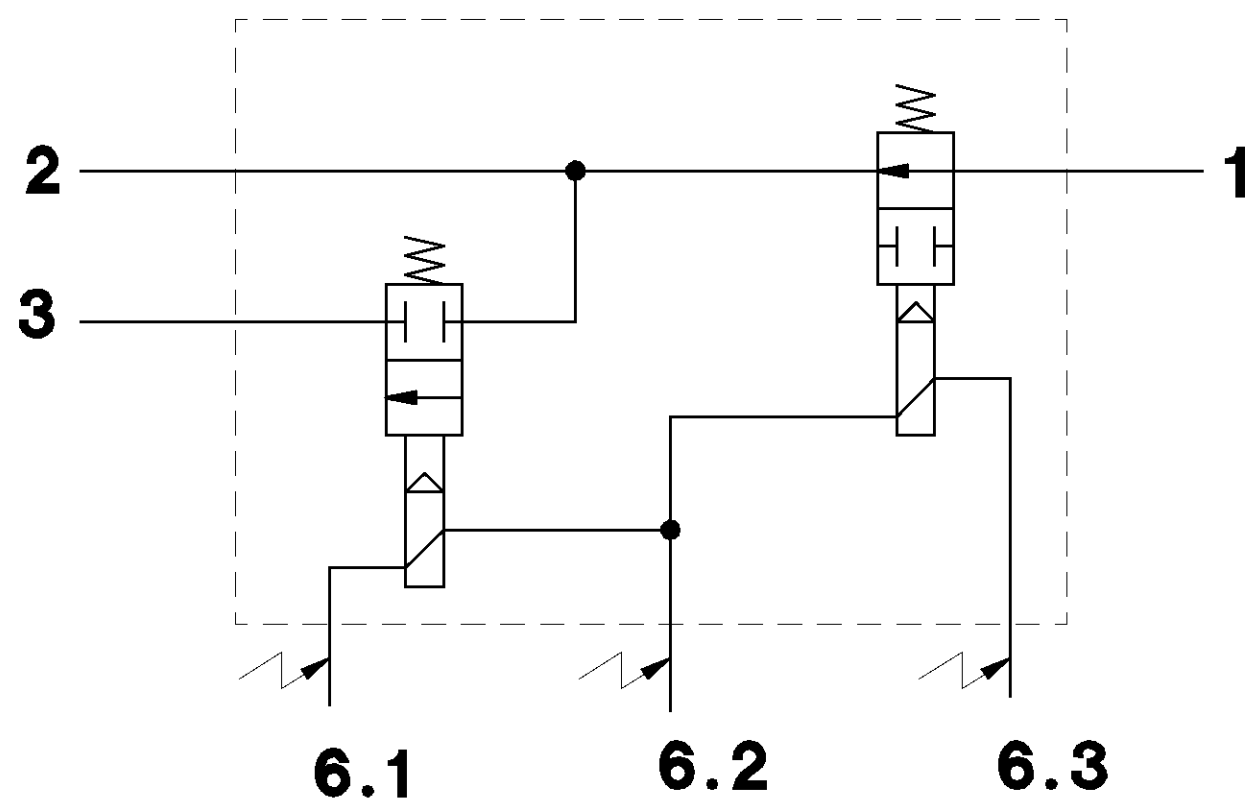 $\pm 15^\circ$ 

- ### 3 EXHAUST ENTLUEFTUNG ECHAPPEMENT SCARICO

- 6.1 ELECTRICAL CONTROL (MAGNET)
6.2 ELEKTRISCHER STEUERANSCHLUSS (MAGNET)
6.3 COMMANDE ELECTRIQUE (AIMANT)
6.3 COMMANDO ELECTRICO (MAGNETE)

472 195 077 0
(CODE 435)

605/653 1009/0163/04 93